



Digital Temperature Controller

www.foxeng.co.kr

DAE SUNG E.N.G




-FOX-2002
-FOX-2002RS
-FOX-2002SR

DAE SUNG E.N.G

Model	Sensor	Output	Temp. Range	Function
FOX-2002	NTC	relay	-55.0°C ~ +99.9°C	temp. control
		relay		alarm control
FOX-2002RS	NTC	relay	-55.0°C ~ +99.9°C	temp. control
		SSR		alarm control
FOX-2002SR	NTC	SSR	-55.0°C ~ +99.9°C	temp. control
		relay		alarm control

※ Thank you for selecting our products. Please read carefully this instruction to reduce any damages or operation mistakes

■ Part name

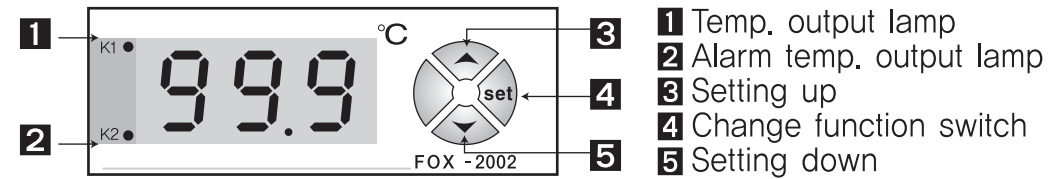


■ The function of each key.

- : A key to change of the programs & setting temperature.
- : A key to change of the program's set values & temperature.

■ Detailed manual

- E81** : set values of the main output
- E82** : set values of the auxiliary output
- HSP** : Setting function of the highest limit of temperature range (Maximum set point allowed to the end user)
-Impossible to set up the set value more than **HSP** set value
ex) **HSP** = 25.0°C setting ⇒ impossible to raise the set value more than 25.0°C
- LSP** : Setting function of the lowest limit of temperature range (Minimum set point allowed to the end user)
-Impossible to set up the set value less than **LSP** set value
ex) **LSP** = 10.0°C setting ⇒ impossible to lower the set value less than 10.0°C
- tYP** : Selection of the Cooling (Col) & Heating (HEt)
- dIF** : Selection of the temperature deviation


P : + deviation (in the set point ⇒ off)
ex) setting=10.0°C, tYP: Col, dIF: 5.0 setting=10.0°C, tYP: HEt, dIF: 5.0

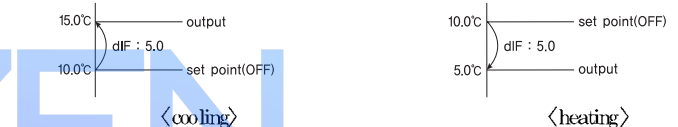


Pn : ± deviation
ex) setting=10.0°C, tYP: Col, dIF: 5.0 setting=10.0°C, tYP: HEt, dIF: 5.0



- dIF** : Setting for temperature deviation
In the ON/OFF control, it needs at regular interval between ON and OFF. By operating the ON/OFF control frequently, the relay or its output contact can be damaged quickly and it also occurs the hunting (oscillating, chattering) by virtue of external noise. You can make use of the temperature deviation in order to protect its relay or contact and so on.
ex ⇒ The method of the temp. deviation when ON/OFF control

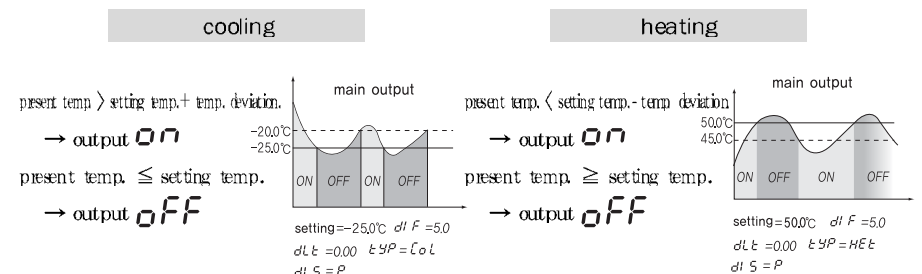

- dLt** : Delay time of the output
It is widely used as the followings
- in case of operating the ON/OFF control very often,
- to protect the operation machinery when re-input of the power supply or momentary stoppage of power supply
ex) if the set value is 13.0,

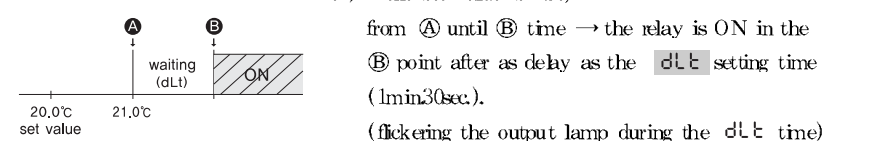


- Cor** : Correction of the present temperature
It is used for the correction of a discrepancy between the display temperature and real temperature.


ex) real temp.: 10.0°C → **Cor**: 0.0 ⇒ -2.0 correction → 10.0°C display

- LoL** : The lock function
- As a safety device, it is used in order not to change the set values except for the main user.
ON- setting for the lock function.
OFF- removal for the lock function

Setting temperature

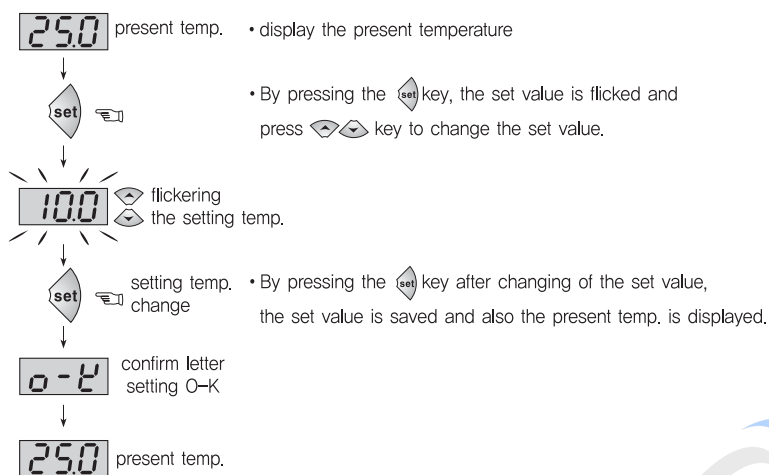


Setting for programs

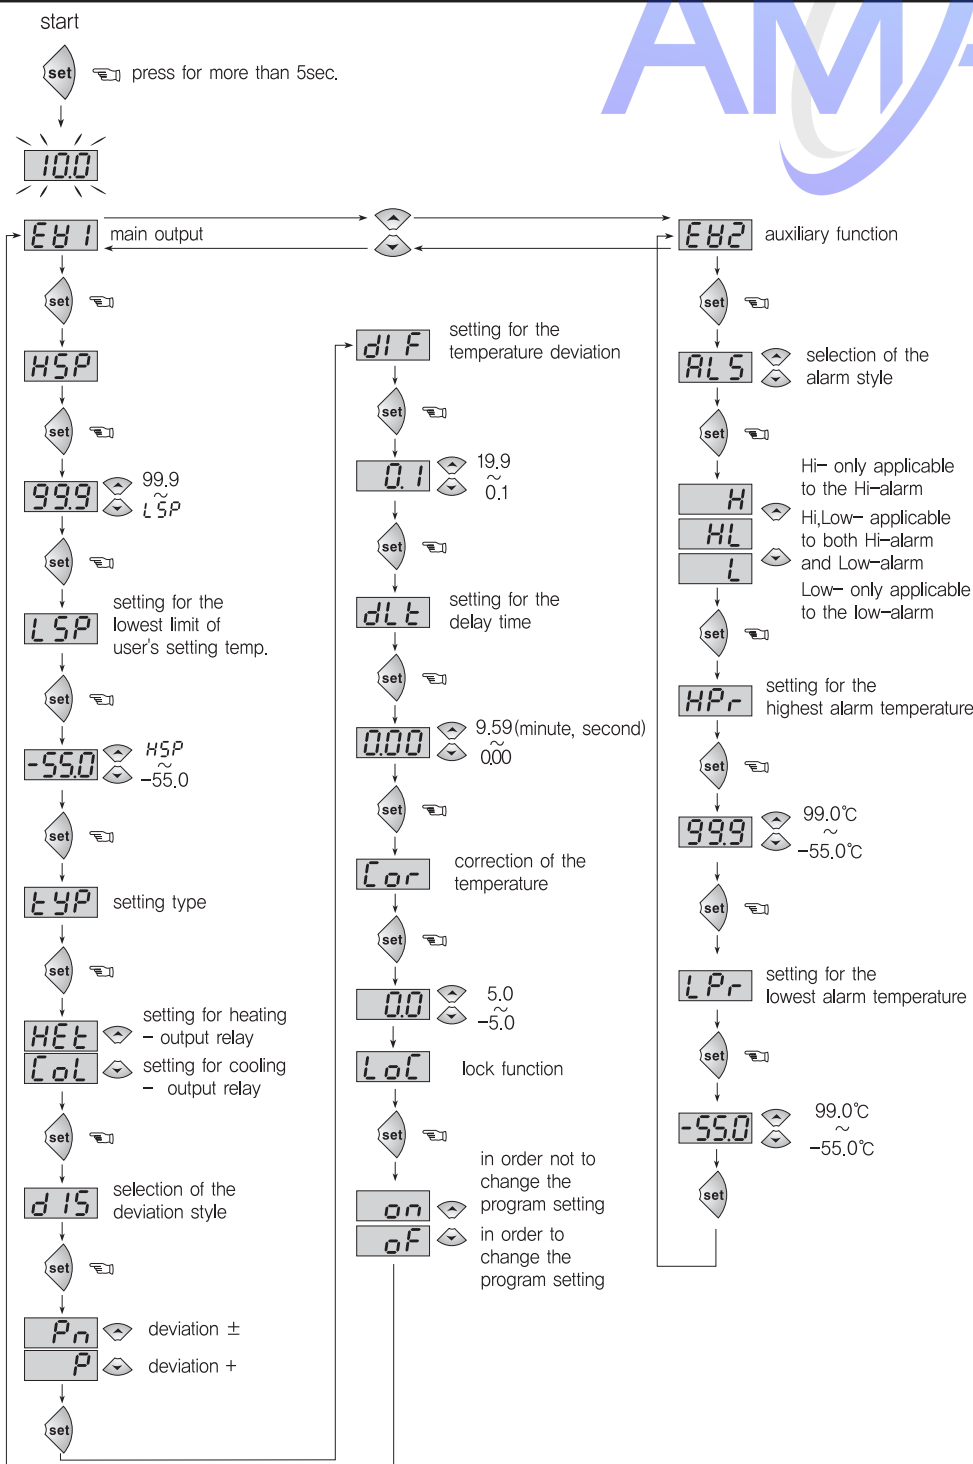


※ To change it with program mode press the key for more than 5 second in the present temperature display mode.
※ The set or programming mode is terminated, if you press the key for 2 second, parameters (set values) are saved after the display shows OK letter or return to present temperature automatically after 30 second.


11. **HP_r** : setting temp. of the highest alarm.
-To prevent an excess of temperature highest limit under control
12. **LP_r** : setting temp. of the lowest alarm.
-To prevent an excess of temperature lowest limit under control
13. **ALS** : style of alarm output
H : output on-only the present temperature is more than **HP_r** set value
ex) **HP_r** : 50.0°C

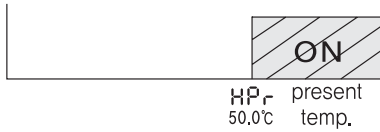

- HL** : output on-the present temperature is both more than **HP_r** and less than **LP_r**
ex) **HP_r** : 50.0°C, **LP_r** : 10.0°C

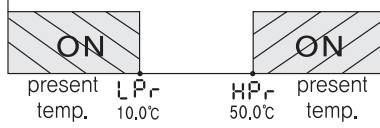


- L** : output on - only the present temperature is less than **LP_r** set value.
ex) **LP_r** : 10.0°C

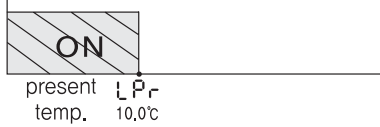

Temp. range & set value when deliver


Setting temp.	Function	Display	Range	Set values when deliver	Remarks
Setting temp.	Setting temp.		-55.0~99.9	10.0	
Program Setting	Setting for the highest limit of user	HSP	LSP~99.9	99.9	It is irrelevant to the relay output.
	Setting for the lowest limit of user	LSP	-55.0~HSP	-55.0	It is irrelevant to the output relay.
	Selection of the function	typ	COL/HEt	COL	HEt - heating COL - cooling
	Selection of the deviation style	dis	P/Pn	P	Pn - deviation ± P - deviation +
	Temperature deviation	dif	0.1~19.9	1.0	
	Delay time	dlb	0.00~9.59	0.00	(minute, second)
	Correction of temp.	cor	-5.0~5.0	0.0	correct for an discrepancy between the display temp. and real temp.
Program Setting	Lock function	loc	on/of	of	on - setting for the lock function of - removal of the lock function however, except for the setting temperature value.
	style of the alarm output	ALS	L HL H	HL	L - lowest alarm temp. HL - both L and H H - highest alarm output
	highest alarm temp.	HP _r	-55.0~99.9	99.9	
	lowest alarm temp.	LP _r	-55.0~99.9	-55.0	

ex) SSR junction

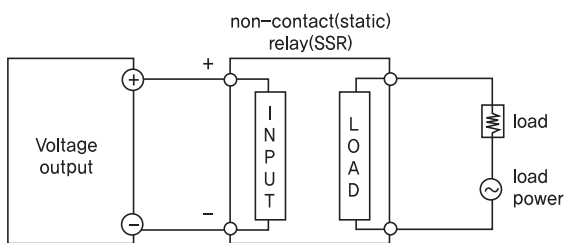


※ Please make sure that the SSR's capacity should be used more than load capacity.

ex) Relay junction

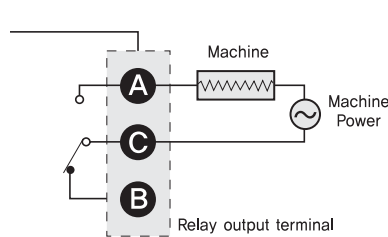


Connection

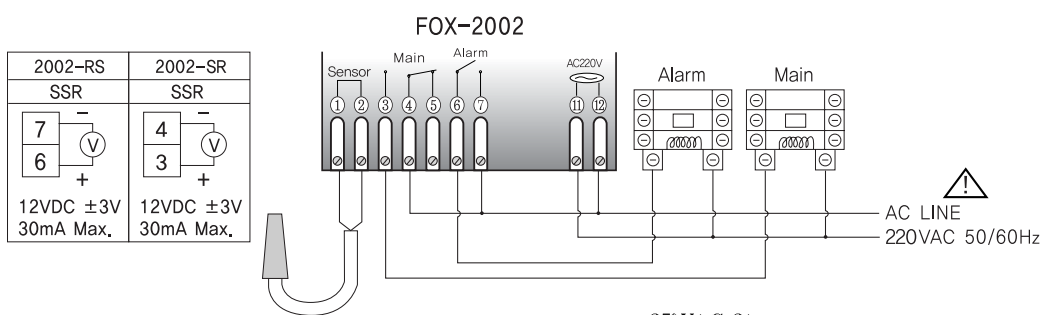

※ output : 250VAC 2A
Please make use of the power relay or magnet surety.

Dimension

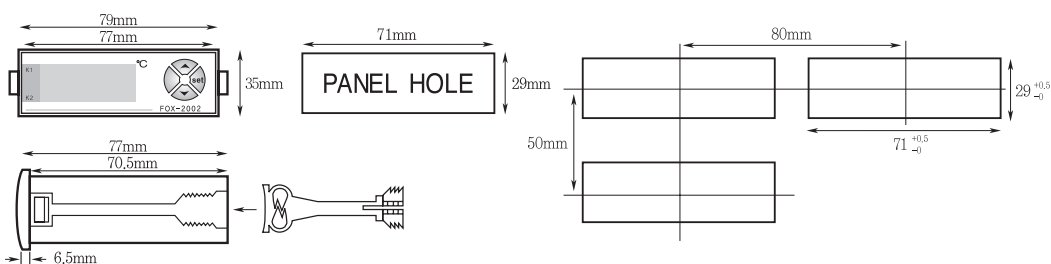

Safety and Hazard Instructions



Pls use this item after installing the duplex safety device in which is applied at dangerous factors such as serious human injury or serious damages of property & important machine because this item is not designed as safety device

⚠ Safety Instruction and Hazard Warnings

- Please read the operating manual through completely before putting the device into operation.
- We will not assume any responsibility for damage to assets or persons caused by improper handling or failure to observe the safety instructions or hazard warnings.
- For safety and licensing reasons, unauthorized conversion and/or modification of the device is not permitted.
- Do not exceed the maximum permissible current - in case of higher loads, use a contactor of adequate power. Make sure that the supplied voltage matches the values specified for the instrument.
- The device must be adequately protected from water and dust as per the application and must be accessible via the use of appropriate tools
- The device must not be exposed to extreme temperature, sunlight, strong vibrations or high levels of humidity.
- Operation or installation is not permitted under unfavorable ambient conditions such as wetness or excessive induction loads or solenoid and dust, combustible gases, vapors or solvents, especially high-frequency noise
- Avoid operation or installation close to high-frequency fields such as welding devices, sewing machines, wireless transmitter, radio systems, SCR controller, etc
- Do not install the sensor cable nearby signal cable, power cable, load cable
- Please use the shield cable when the sensor cable's lengthen, however do not make it too much longer
- Please use the sensor cable without any cutting or flaw, blemish.
- The device is not a toy and should be kept away from children
- Installation work must only be carried out by suitably qualified personnel who are familiar with the hazards involved and with the relevant regulations.
- You shouldn't tinker with anything or the product may not be opened or disassembled unless you know what you're doing. Please ask us about this questioning

⚠ Danger

Attention ! Never work on electrical connections when the machine is switched on

Error message

- E r 1** Memory error. Turn the power off and turn it on again
If the error message persists, please request us A/S by return
- o - E** Sensor error. The sensor is interrupted. Check the cable.
- S - E** Sensor error. The sensor is short-circuited. Check the cable

■ The terms of guarantee : within 18months after shipment date.

Model & output spec

	2001 (sensor : 1EA)	2001D (sensor : 1EA)	2001T (sensor : 1EA)	2001F (sensor : 1EA)	2000TT (sensor : 1EA)
temp. output	one-stage output	two-stage output	three-stage output	four-stage output	control by the temperature & time (for greenhouses)

	2001 (sensor : 1EA)	2002 (sensor : 1EA)	2003, 2003S (sensor : 1EA)	2004 (sensor : 2EA)	2005 (sensor : 2EA)	2006 (sensor : 2EA)	
temp. output	○	○	○	○	○	temp. 1	temp. 2
alarm output	-	○	-	-	○	alarm 1	alarm 2
defrost output	-	-	○	○	○	-	-
FAN output	-	-	○	○	○	-	-

ex) application

- ex)Heater → turn off at 30.0, turn on at 25.0
→ How to operate(setting for the temperature & programs)?

<setting temp.> (see the setting temperature)
setting : 30.0°C
<setting program> (see the setting for program)
typ : HEt
dis : P (deviation → one side, set point → off)
dif : 5.0 (on/off interval ⇒ 5.0°C)
- ex)Cooler → turn off at 0.0, turn on at 2.0
→ How to operate(setting for the temperature & programs)?

<setting temp.> (see the setting temperature)
setting : 0.0°C
<setting program> (see the setting for program)
typ : COL
dis : P (deviation → one side, set point → off)
dif : 2.0 (on/off interval ⇒ 2.0°C)
- ex)Heater → turn off at 70.0, turn on at 60.0, alarm output ⇒ when more than 70.0°C
: How to operate ?

<setting temp.> (see the setting temperature)
setting : 70.0°C
<setting program> (see the setting for program)
main setting
typ : HEt (heating)
dis : P (deviation → one side, set point → off)
dif : set point → off : 10.0°C (on/off interval ⇒ 10.0°C)
auxiliary setting
HP_r : 70.0°C (setting for the highest alarm temperature)
ALS : H (output on -when the present temperature is more than HP_r set value)

※ The product's specification can be changed without any notification to improve its quality.

■ H. Office : B-112, Techno plaza 681-11
Junpo 1 dong, Busanjin-ku,
Busan, Korea
Factory : B-408, 409, 410
Techno plaza 681-11
Junpo 1 dong, Busanjin-ku,
Busan, Korea
A/S TEL : +82-51-819-0426
FAX : 82-51-819-4562
E-mail : foxeng@foxeng.co.kr
Homepage : http://www.foxeng.co.kr

※ This device works proper operation with:
Surrounding Temp. : 0°C~60°C
Surrounding Humi. : below 80%RH
Regular power : 220VAC ±10% 50/60Hz